NOTE:

1. SEE SHEET 1 FOR FOR FOOTING MATERIAL SCHEDULE, FABRICATION NOTES AND ADDITIONAL FOOTING DETAIL.

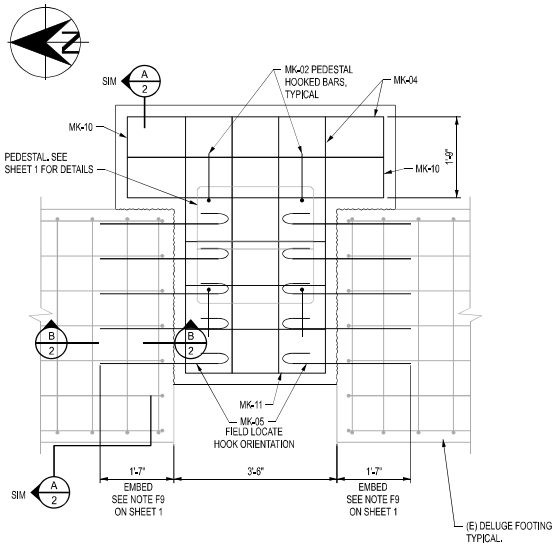

500KV INSULATOR PEDESTAL (MID) FOOTING
REINFORCING PLAN
MK-IP3

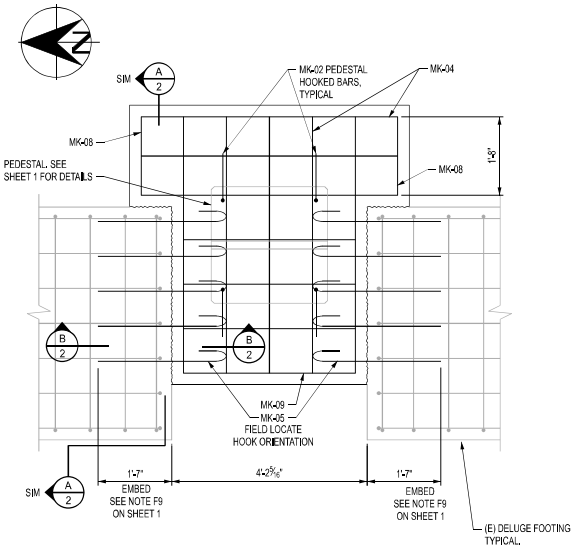

500KV INSULATOR PEDESTAL (MID) FOOTING
REINFORCING PLAN
MK-IP2

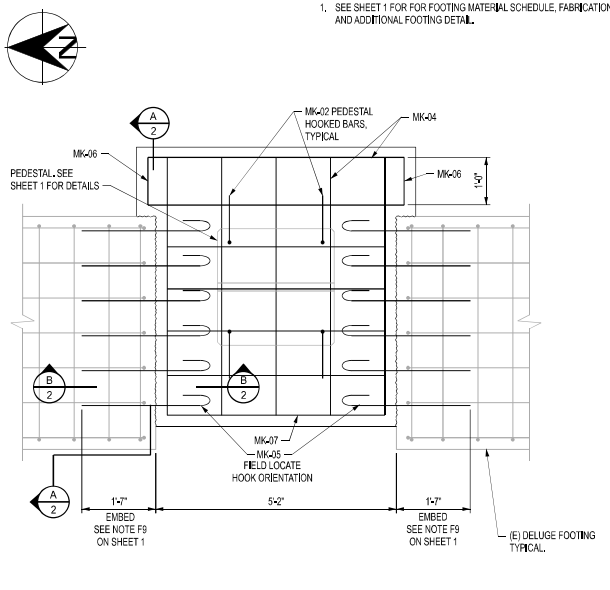

500KV INSULATOR PEDESTAL (MID) FOOTING
REINFORCING PLAN
MK-IP1

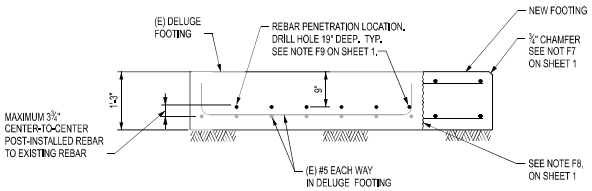

SECTION A/2 A/2

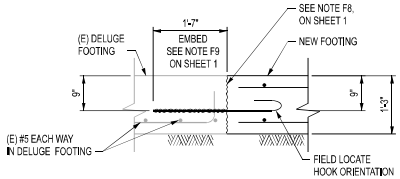

SECTION B/2 B/2

NO.	FA	W.O. 629712	DESCRIPTION	BY	DATE	POC/APPROVED BY

DESIGNED BY: DSGN: BPA PJ/JBRAVERMAN
DRWN: BPA/R.,/.MAMLIN
CHKD: BPA/B.C.WUHRGREN
REVN:
CNCR:

BONNEVILLE POWER ADMINISTRATION
UNITED STATES DEPARTMENT OF ENERGY

COLUMBIA GENERATION STATION
FOOTING DETAILS
500KV INSULATOR PEDESTAL (MID) REINFORCING PLANS
MK-IP1, MK-IP2 & MK-IP3

APPROVED BY: TELO
DATE: 05/11/2026

SOURCE	SIZE	SERIAL	SHEET	REVISION
SFS	ANSI D	362627	2	0

NOT APPROVED UNTIL DIGITALLY SIGNED & CERTIFIED ICON APPEARS BELOW TITLE BLOCK